



IECC 2021 Zūm[®] Wired Solutions Hospitality Applications

Crestron Electronics, Inc.

Original Instructions

The U.S. English version of this document is the original instructions.
All other languages are a translation of the original instructions.

Crestron product development software is licensed to Crestron dealers and Crestron Service Providers (CSPs) under a limited nonexclusive, nontransferable Software Development Tools License Agreement. Crestron product operating system software is licensed to Crestron dealers, CSPs, and end-users under a separate End-User License Agreement. Both of these Agreements can be found on the Crestron website at www.crestron.com/legal/software_license_agreement.

The product warranty can be found at www.crestron.com/warranty.


The specific patents that cover Crestron products are listed at www.crestron.com/legal/patents.

Certain Crestron products contain open source software. For specific information, visit www.crestron.com/opensource.





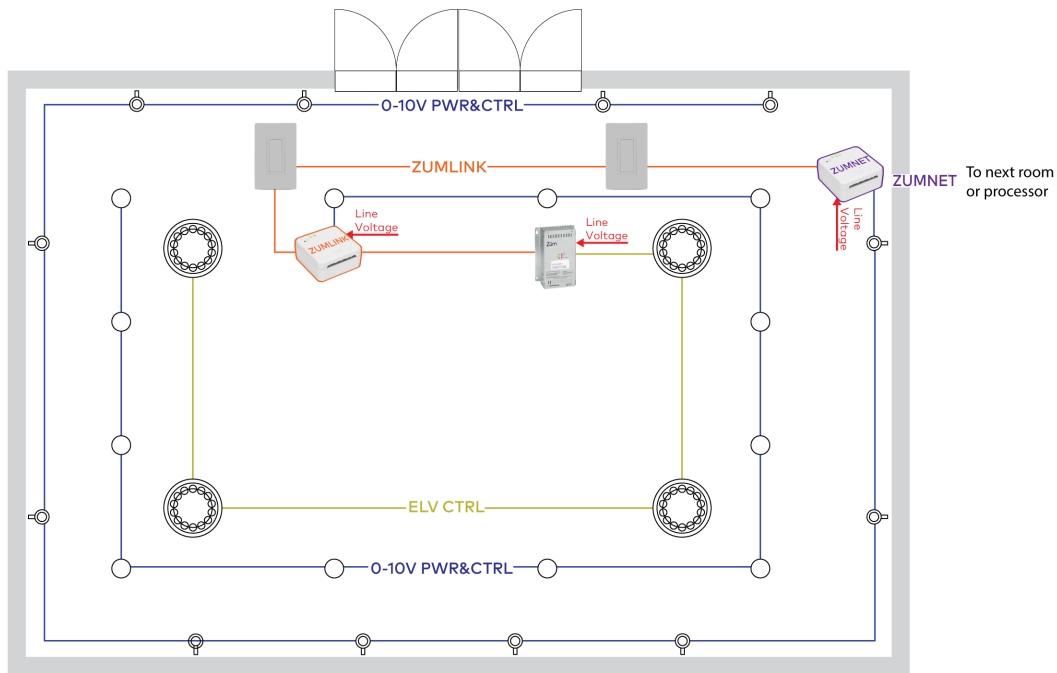

Crestron, the Crestron logo, and Zūm are either trademarks or registered trademarks of Crestron Electronics, Inc. in the United States and/or other countries. DALI is either a trademark or registered trademark of IEEE Industry Standards and Technology Organization, Inc. in the United States and/or other countries. Other trademarks, registered trademarks, and trade names may be used in this document to refer to either the entities claiming the marks and names or their products. Crestron disclaims any proprietary interest in the marks and names of others. Crestron is not responsible for errors in typography or photography.

©2021 Crestron Electronics, Inc.

Zūm® Wired: 0 - 10V Drivers



Bill of Materials


Item	Product	Qty
	ZUMNET-JBOX-16A-LV Zūm Net, Dimmer, 0-10V, 16A	1
	ZUMLINK-JBOX-16A-LV Zūm Link, Dimmer, 0-10V 16A	1
	ZUMLINK-JBOX-DIMU Zūm Link, Universal Dimmer	1
	ZUMLINK-KP Zūm Link Keypad, Manual Control	2
	CBL-CAT5E-ZUMLINK-P Zūm Link CAT5e, various lengths	TBD
	CBL-CAT5E-ZUMNET-P Zūm Net CAT5e, various lengths	TBD

Code







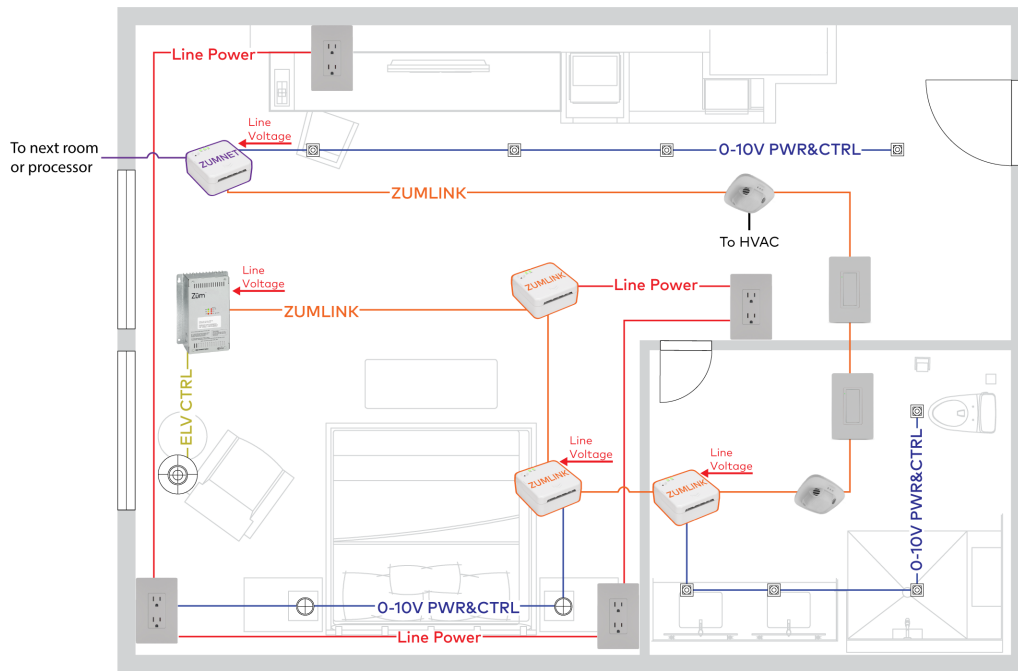


Manual Control Device
C405.2.3.1, C405.2.6
Physical control interface for occupant

Programmable Timeclock
C405.2.2.1, C405.2.7.1,
C405.2.7.2, C405.2.7.3,
C405.2.7.4
Programmed time Auto On,
Auto Off

Züm® Wired: 0 - 10V Drivers




Bill of Materials

Item	Product	Qty
	ZUMNET-JBOX-16A-LV Züm Net, Dimmer, 0-10V, 16A	1
	ZUMLINK-JBOX-16A-LV Züm Link, Dimmer, 0-10V, 16A	2
	ZUMLINK-JBOX-20A-PLUG Züm Link, Plug, 20A	1
	ZUMLINK-JBOX-DIMU Züm Link, Universal Dimmer	1
	ZUMLINK-KP Züm Link Keypad, Manual Control	2
	ZUMLINK-DT-QUATTRO-DLS-RLY Züm Link Presence Detector/ Closed-Loop Daylight Sensor with HVCA Relay Output	2
	Receptacle	4
	CBL-CAT5E-ZUMLINK-P Züm Link CAT5e, various lengths	TBD
	CBL-CAT5E-ZUMNET-P Züm Net CAT5e, various lengths	TBD







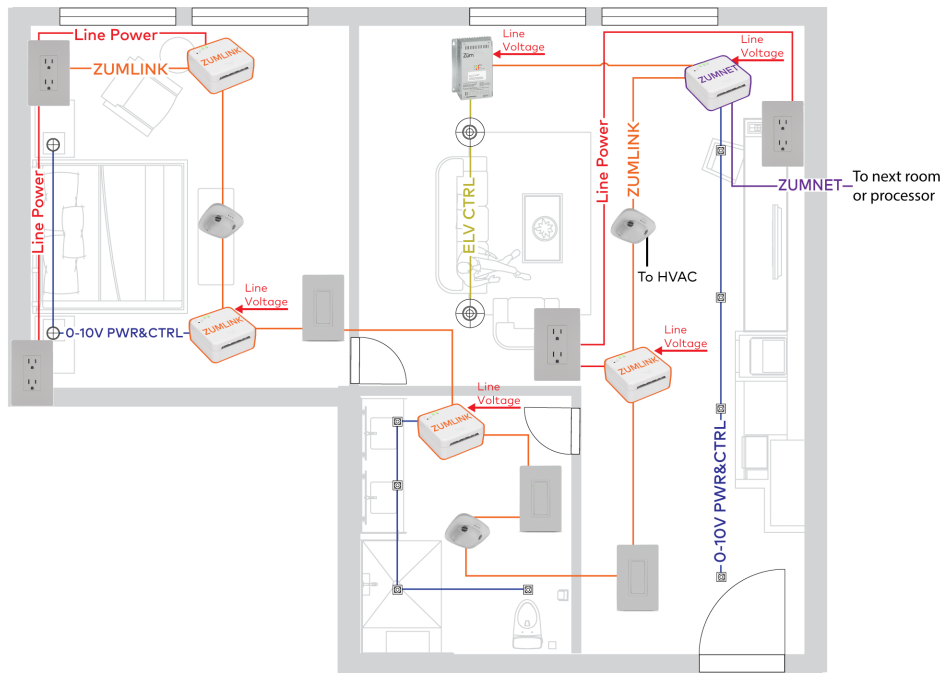

Code

- Manual Control Device**
C405.2.3.1, C405.2.6
Physical control interface for occupant
- Occupancy Sensor**
C405.2.1, C405.2.1.1
Motion detection: Automatic On, Automatic Off
- Vacancy Sensor**
C405.2.1.1
Motion detection: Manual On, Automatic Off
- Controlled Receptacles**
C405.11, C405.11.1,
Control of receptacle power
- Automatic Control of HVAC System Serving Guest Rooms**
C403.7.6
HVAC control based on occupancy

Zūm® Wired: 0 - 10V Drivers




Bill of Materials

Item	Product	Qty
	ZUMNET-JBOX-16A-LV Zūm Net, Dimmer, 0-10V, 16A	1
	ZUMLINK-JBOX-16A-LV Zūm Link, Dimmer, 0-10V 16A	2
	ZUMLINK-JBOX-20A-PLUG Zūm Link, Plug, 20A	2
	ZUMLINK-JBOX-DIMU Zūm Link, Universal Dimmer	1
	ZUMLINK-KP Zūm Link Keypad, Manual Control	3
	ZUMLINK-DT-QUATTRO-DLS-RLY Zūm Link Presence Detector/ Closed-Loop Daylight Sensor with HVCA Relay Output	3
	Receptacle	4
	CBL-CAT5E-ZUMLINK-P Zūm Link CAT5e, various lengths	TBD
	CBL-CAT5E-ZUMNET-P Zūm Net CAT5e, various lengths	TBD






Code

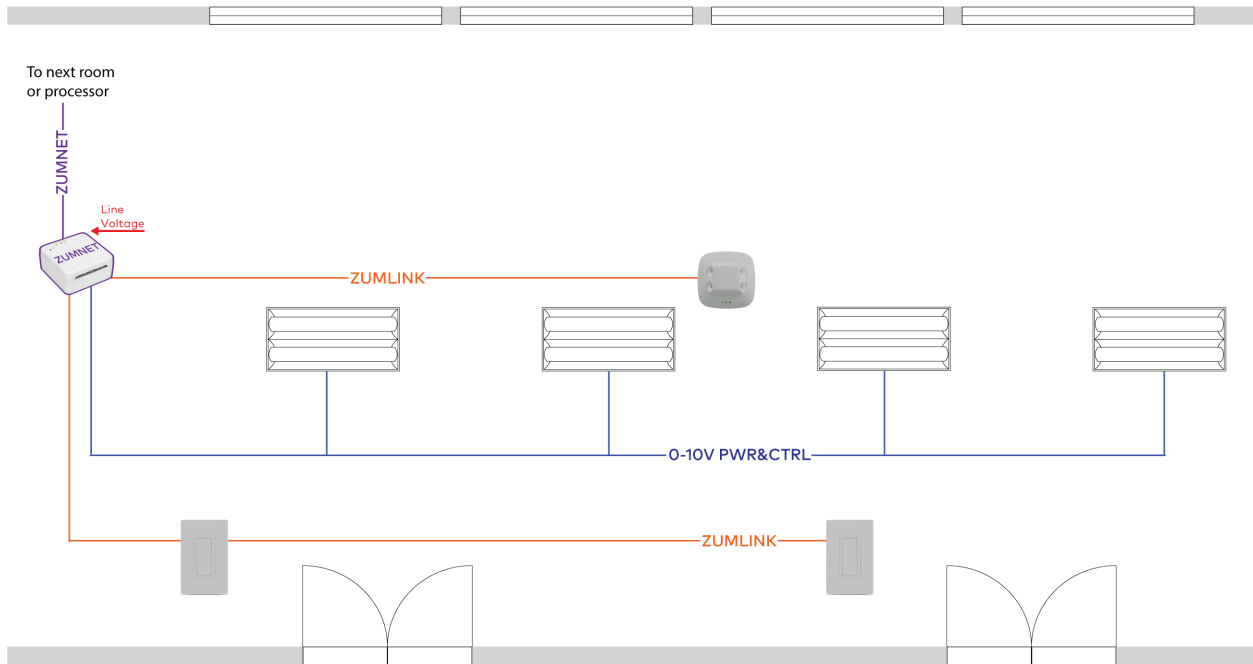- Manual Control Device**
C405.2.3.1, C405.2.6
Physical control interface for occupant
- Occupancy Sensor**
C405.2.1, C405.2.1.1
Motion detection: Automatic On, Automatic Off
- Vacancy Sensor**
C405.2.1.1
Motion detection: Manual On, Automatic Off
- Controlled Receptacles**
C405.11, C405.11.1,
Control of receptacle power
- Automatic Control of HVAC System Serving Guest Rooms**
C403.7.6
HVAC control based on occupancy

Zūm® Wired: 0 - 10V Drivers



Bill of Materials

Item	Product	Qty
	ZUMNET-JBOX-16A-LV Zūm Net, Dimmer, 0-10V, 16A	1
	ZUMLINK-KP Zūm Link Keypad, Manual Control	2
	ZUMLINK-US-HALLWAY-DLS Zūm Link Presence Detector Closed-Loop Daylight Sensor	1
	CBL-CAT5E-ZUMLINK-P Zūm Link CAT5e, various lengths	TBD
	CBL-CAT5E-ZUMNET-P Zūm Net CAT5e, various lengths	TBD

Code

Manual Control Device

C405.2.3.1, C405.2.6
Physical control interface for occupant


Occupancy Sensor

C405.2.1, C405.2.1.1
Motion detection: Automatic On, Automatic Off





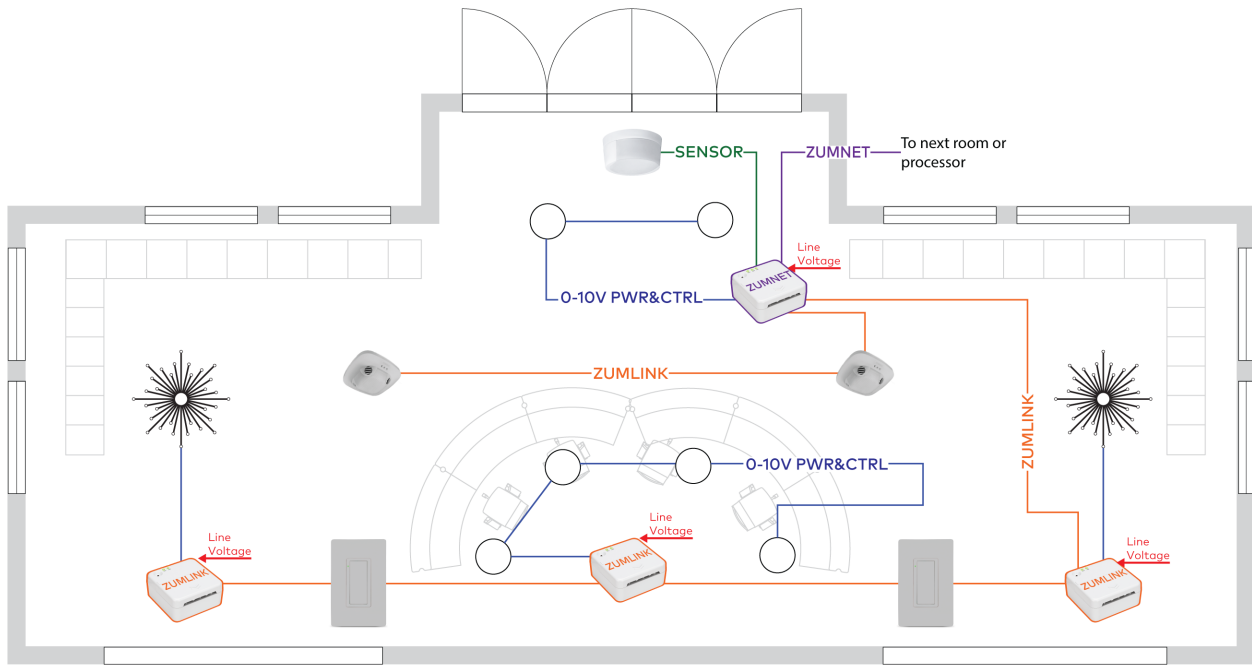


Daylight Response

C405.2.4, C405.2.4.1, C405.2.7.1
Exception C405.2.4.1
Adjust lights based on available daylight

Zūm® Wired: 0 - 10V Drivers



Bill of Materials

Item	Product	Qty
	ZUMNET-JBOX-16A-LV Zūm Net, Dimmer, 0-10V, 16A	1
	ZUMLINK-JBOX-16A-LV Zūm Link, Dimmer, 0-10V 16A	3
	ZUMLINK-KP Zūm Link Keypad, Manual Control	2
	ZUMLINK-DT-QUATTRO-DLS Zūm Link Presence Detector/ Closed-Loop Daylight Sensor	2
	GLA-LDL-PC-0-10 Open/Closed Loop Daylight Sensor	1
	CBL-CAT5E-ZUMLINK-P Zūm Link CAT5e, various lengths	TBD
	CBL-CAT5E-ZUMNET-P Zūm Net CAT5e, various lengths	TBD

Code


- Manual Control Device**
C405.2.3.1, C405.2.6
Physical control interface for occupant

- Programmable Timeclock**
C405.2.2.1, C405.2.7.1,
C405.2.7.2, C405.2.7.3,
C405.2.7.4
Programmed time Auto On,
Auto Off





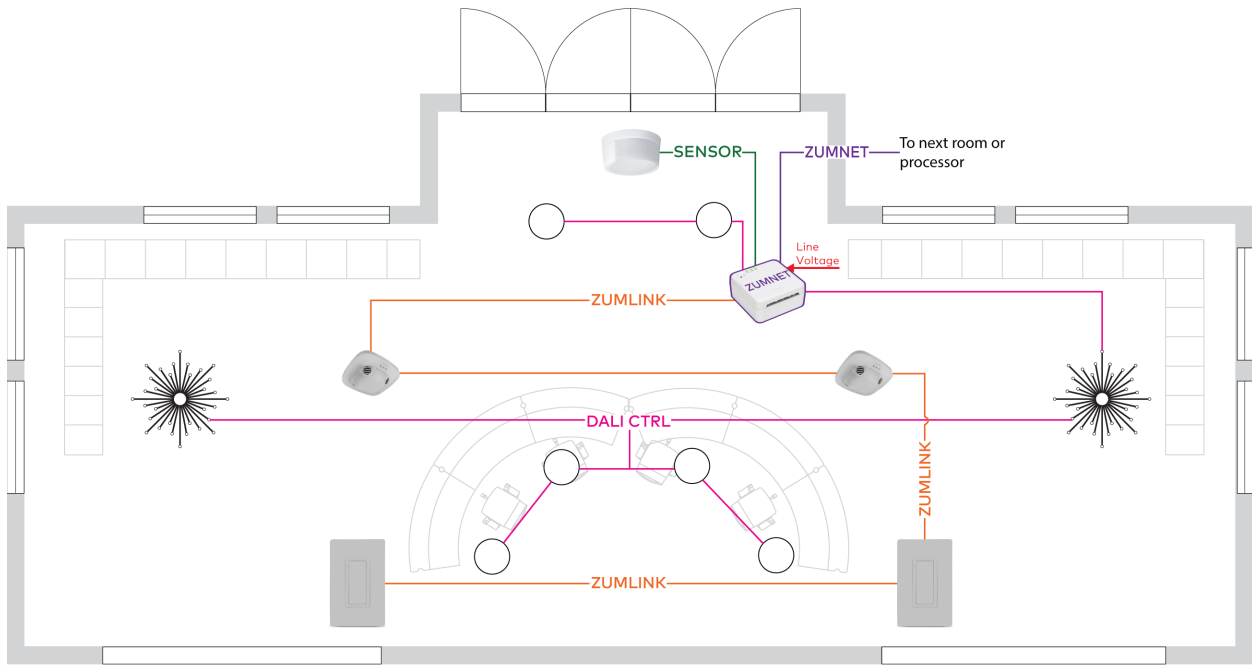

- Occupancy Sensor**
C405.2.1, C405.2.1.1
Motion detection: Automatic
On, Automatic Off

- Daylight Response**
C405.2.4, C405.2.4.1,
C405.2.7.1
Exception C405.2.4.1
Adjust lights based on
available daylight

Zūm® Wired: DALI® Drivers




Bill of Materials

Item	Product	Qty
	ZUMNET-JBOX-DALI Zūm Net, DALI	1
	ZUMLINK-KP Zūm Link Keypad, Manual Control	2
	ZUMLINK-DT-QUATTRO-DLS Zūm Link Presence Detector/ Closed-Loop Daylight Sensor	2
	GLA-LDL-PC-0-10 Open/Closed Loop Daylight Sensor	1
	CBL-CAT5E-ZUMLINK-P Zūm Link CAT5e, various lengths	TBD
	CBL-CAT5E-ZUMNET-P Zūm Net CAT5e, various lengths	TBD

Code

- Manual Control Device**
C405.2.3.1, C405.2.6
Physical control interface for occupant
- Programmable Timeclock**
C405.2.2.1, C405.2.7.1,
C405.2.7.2, C405.2.7.3,
C405.2.7.4
Programmed time Auto On,
Auto Off
- Occupancy Sensor**
C405.2.1, C405.2.1.1
Motion detection: Automatic
On, Automatic Off
- Daylight Response**
C405.2.4, C405.2.4.1,
C405.2.7.1
Exception C405.2.4.1
Adjust lights based on
available daylight

Zūm® Wired: 0 - 10V Drivers

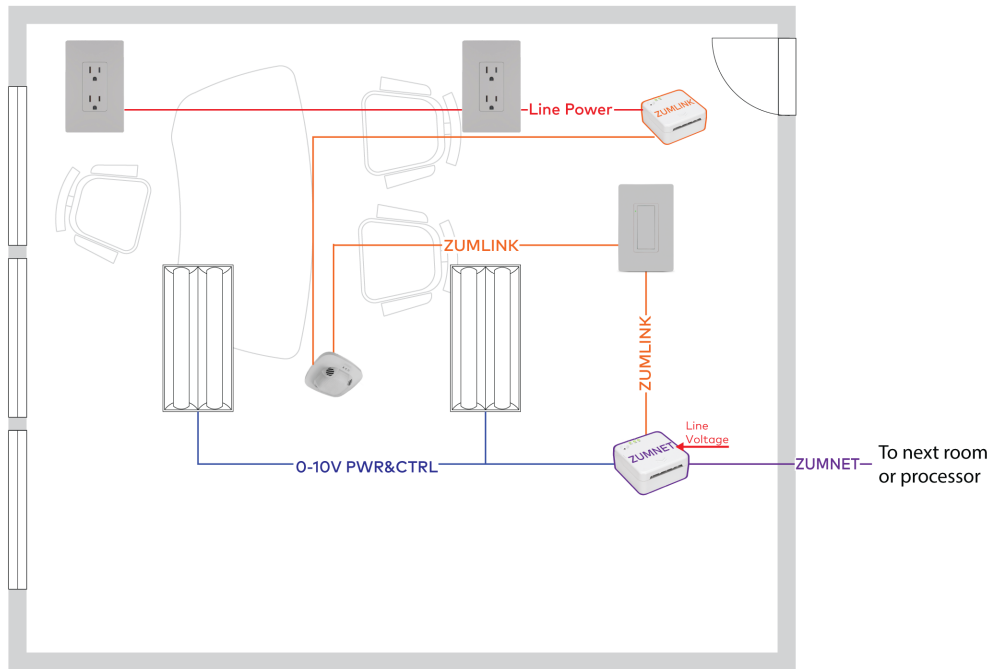

Bill of Materials

Item	Product	Qty
	ZUMNET-JBOX-16A-LV Zūm Net, Dimmer, 0-10V, 16A	1
	ZUMLINK-JBOX-20A-PLUG Zūm Link, Plug, 20A	1
	ZUMLINK-KP Zūm Link Keypad, Manual Control	1
	ZUMLINK-DT-QUATTRO-DLS Zūm Link Presence Detector/ Closed-Loop Daylight Sensor	1
	Receptacle	2
	CBL-CAT5E-ZUMLINK-P Zūm Link CAT5e, various lengths	TBD
	CBL-CAT5E-ZUMNET-P Zūm Net CAT5e, various lengths	TBD

Code

Manual Control Device
C405.2.3.1, C405.2.6
Physical control interface for occupant


Occupancy Sensor
C405.2.1, C405.2.1.1
Motion detection: Automatic On, Automatic Off

Vacancy Sensor
C405.2.1.1
Motion detection: Manual On, Automatic Off






Daylight Response
C405.2.4, C405.2.4.1, C405.2.7.1
Exception C405.2.4.1
Adjust lights based on available daylight

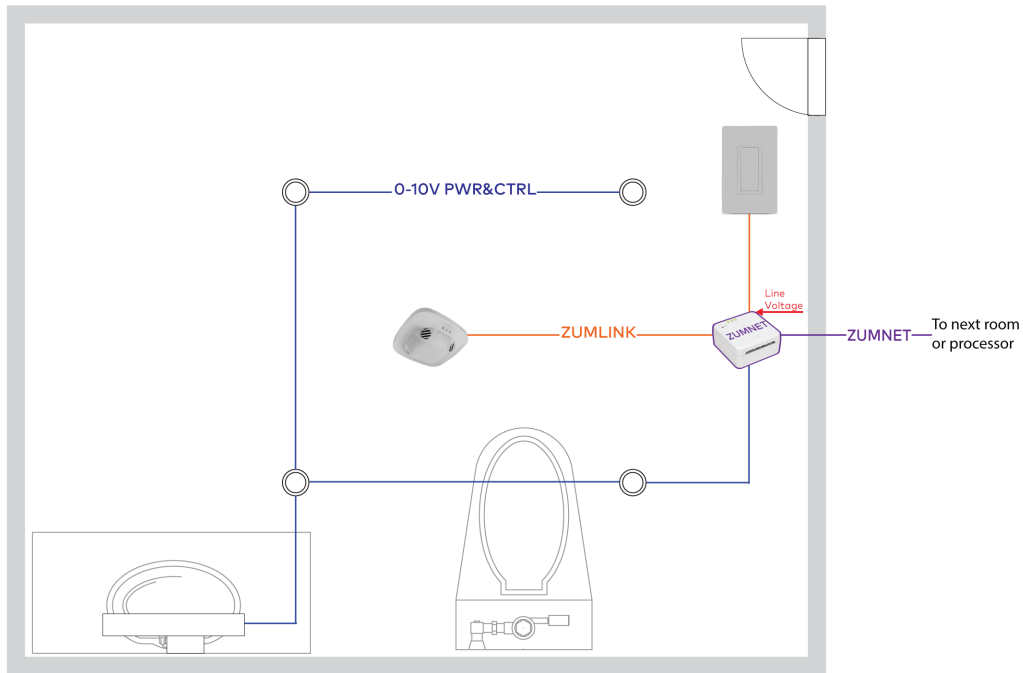Controlled Receptacles
C405.11, C405.11.1,
Control of receptacle power

Zūm® Wired: 0 - 10V Drivers




Bill of Materials

Item	Product	Qty
	ZUMNET-JBOX-16A-LV Zūm Net, Dimmer, 0-10V, 16A	1
	ZUMLINK-KP Zūm Link Keypad, Manual Control	1
	ZUMLINK-DT-QUATTRO-DLS Zūm Link Presence Detector/ Closed-Loop Daylight Sensor	1
	CBL-CAT5E-ZUMLINK-P Zūm Link CAT5e, various lengths	TBD
	CBL-CAT5E-ZUMNET-P Zūm Net CAT5e, various lengths	TBD





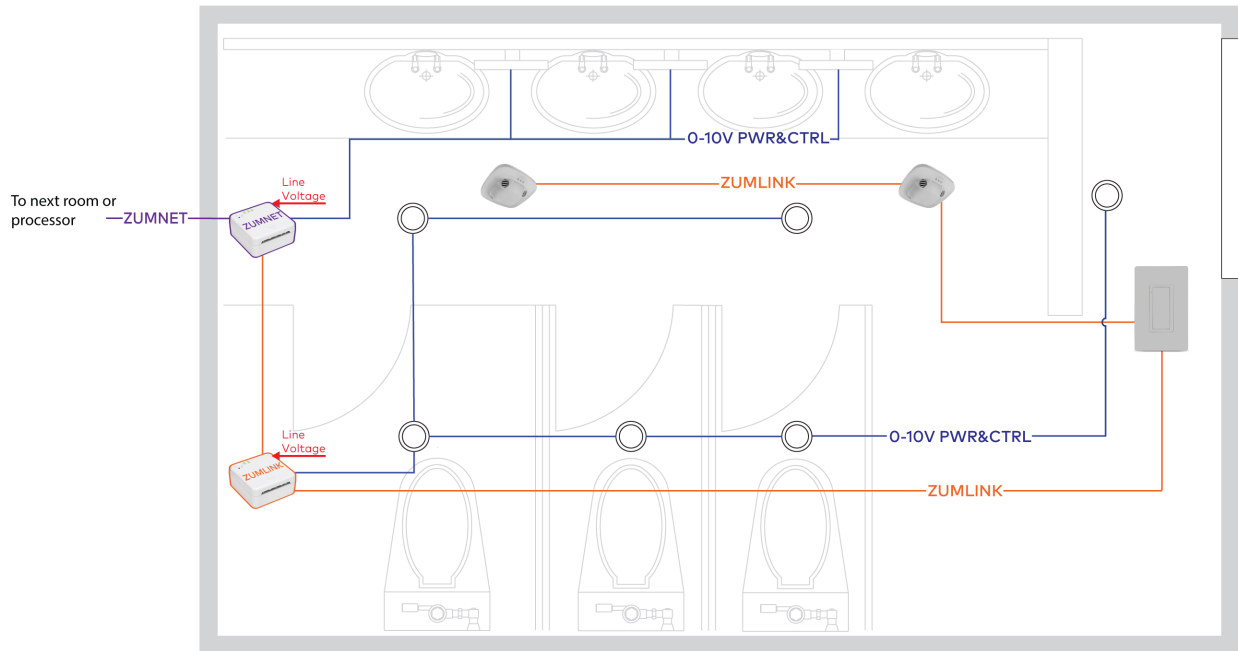

Code

- Manual Control Device**
C405.2.3.1, C405.2.6
Physical control interface for occupant
- Occupancy Sensor**
C405.2.1, C405.2.1.1
Motion detection: Automatic On, Automatic Off
- Daylight Response**
C405.2.4, C405.2.4.1, C405.2.7.1
Exception C405.2.4.1
Adjust lights based on available daylight

Zūm® Wired: 0 - 10V Drivers




Bill of Materials

Item	Product	Qty
	ZUMNET-JBOX-16A-LV Zūm Net, Dimmer, 0-10V, 16A	1
	ZUMLINK-JBOX-16A-LV Zūm Link, Dimmer, 0-10V 16A	1
	ZUMLINK-KP Zūm Link Keypad, Manual Control	1
	ZUMLINK-DT-QUATTRO-DLS Zūm Link Presence Detector/ Closed-Loop Daylight Sensor	2
	CBL-CAT5E-ZUMLINK-P Zūm Link CAT5e, various lengths	TBD
	CBL-CAT5E-ZUMNET-P Zūm Net CAT5e, various lengths	TBD






Code

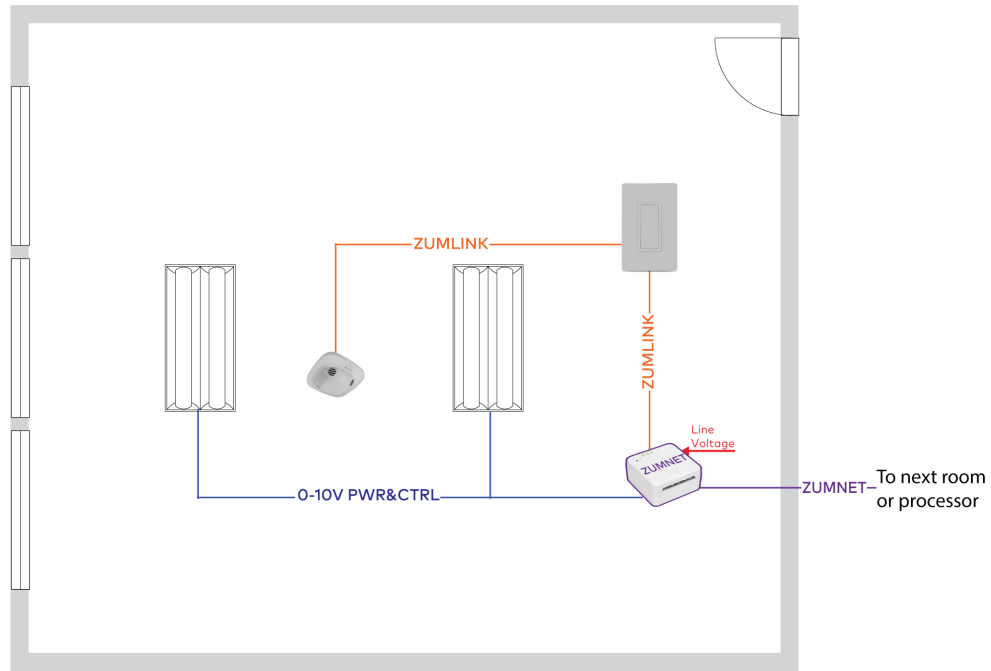- Manual Control Device**
C405.2.3.1, C405.2.6
Physical control interface for occupant
- Occupancy Sensor**
C405.2.1, C405.2.1.1
Motion detection: Automatic On, Automatic Off
- Daylight Response**
C405.2.4, C405.2.4.1, C405.2.7.1
Exception C405.2.4.1
Adjust lights based on available daylight

Zūm® Wired: 0 - 10V Drivers



Bill of Materials

Item	Product	Qty
	ZUMNET-JBOX-16A-LV Zūm Net, Dimmer, 0-10V, 16A	1
	ZUMLINK-KP Zūm Link Keypad, Manual Control	1
	ZUMLINK-DT-QUATTRO-DLS Zūm Link Presence Detector/ Closed-Loop Daylight Sensor	1
	CBL-CAT5E-ZUMLINK-P Zūm Link CAT5e, various lengths	TBD
	CBL-CAT5E-ZUMNET-P Zūm Net CAT5e, various lengths	TBD

Code

- Manual Control Device**
C405.2.3.1, C405.2.6
Physical control interface for occupant
- Occupancy Sensor**
C405.2.1, C405.2.1.1
Motion detection: Automatic On, Automatic Off
- Vacancy Sensor**
C405.2.1.1
Motion detection: Manual On, Automatic Off
- Daylight Response**
C405.2.4, C405.2.4.1, C405.2.7.1
Exception C405.2.4.1
Adjust lights based on available daylight

Contact Info

Name

Company

Address 1

Address 2

City, State, Zip

Phone

Email

Website

Project Notes

Square Footage

Cost/Sq. Ft.

--	--