


Modular Cable Requirements

Use this information sheet for network modular cable connections in a Crestron system.

If the 6-conductor modular cable is used to power Crestron devices, then it must be rated for 30 VDC, 140°F (60°C) minimum. Also, the cable must be rated to carry sufficient current for loads. UL style 20251 cable can be used to carry up to 2 Amps when used in a dual power and dual ground configuration as shown below.

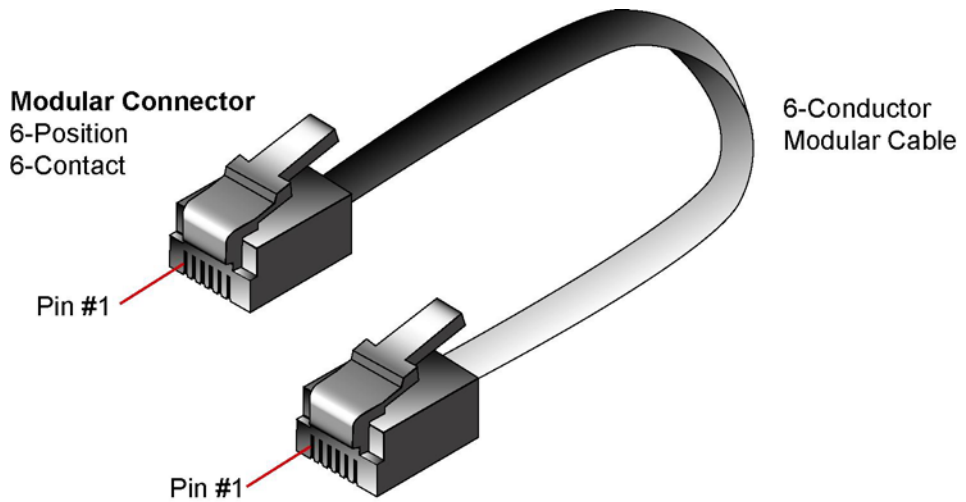

Pin to Pin Wiring

From Pin	Description	To Pin
1	+24 V	1
2	+24 V	2
3	Y	3
4	Z	4
5	GND	5
6	GND	6

NOTE: Most 4-conductor cables are wired in a crisscross fashion and are *not* compatible with Crestron equipment.

